



Assessment & Sustainable Replacement Options

155 George Street, Prince George, BC
Presented to: Regional District of Fraser-Fort
George (RDFFG)
Prepared by: McCuaig & Associates
Engineering Ltd.
Date: February 20, 2024



AGENDA

- MAE Introduction
- Building Description
- Existing HVAC Assessment
- Energy & GHG Analysis
- Sustainable Replacement Options
- Recommendations
- Q&A

Company Introduction

- Founded: 1992 by Jak McCuaig
- Offices: Vancouver, Victoria, Calgary
- Staff: 40+ engineers, technologists, technicians, and administrative personnel
- Services:
 - ❖ Building asset management
 - ❖ Building science
 - ❖ Mechanical
 - ❖ Electrical
 - ❖ Energy Performance
 - Hazmat

McCuaig and Associates Engineering

Clients :

- ❖ Federal/Provincial/ Municipal governments
- ❖ School Boards
- ❖ Housing providers
- ❖ Large Portfolio Holders

McCUAIG & ASSOCIATES ENGINEERING

Today's Speaker



LEAD CONSULTANTS



Dmitrii Konkov, P. ENG.

Today's Discussion...





Building Description

155 George Street, Prince George, BC

- Location: 155 George St, Prince George, BC. ASHRAE 4A Zone with 4720 HDD
- Year Built: 1999, 3 storeys, 27,934 sq. ft.
- Occupancy: RFFFG administrative offices
- Structure: Wood-framed, triple-glazed windows
- HVAC: Hydronic boilers, air-cooled chiller, 1 large AHU, fan coils






Existing HVAC

Distribution


- 24 4- pipe fan coils
- All replaced in 2021 and in good condition
- Minor design issues when supply air goes to one room but returns from another
- All fan coils are “high temperature” fan coils

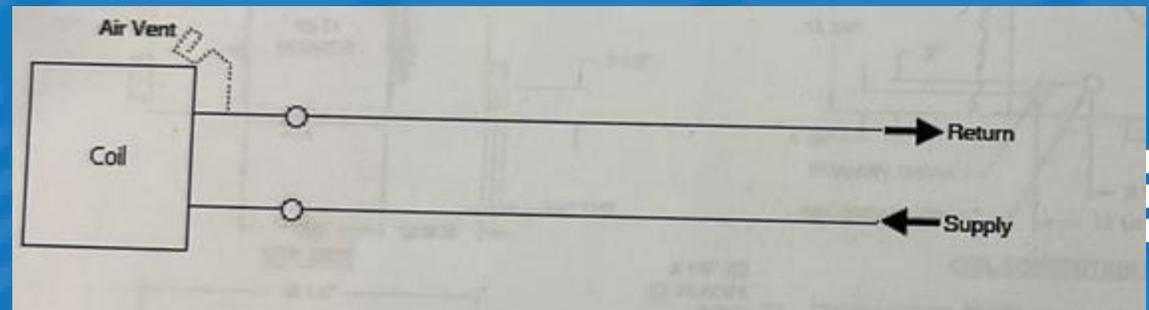

Existing HVAC

Heating


- 6 condensing boilers, ~270 MBH each
 - 2 IBC boilers installed in 2021. Good Condition
 - 1 Lochinvar installed in 2021. Good Condition
 - 3 HydroTherm boilers original to the building. Poor condition
- Issues:
 - Operating at non-condensing temps (~180°F).
 - Coupled DHW prevents lower return temps.
 - Three boilers used only for backup in extreme cold.

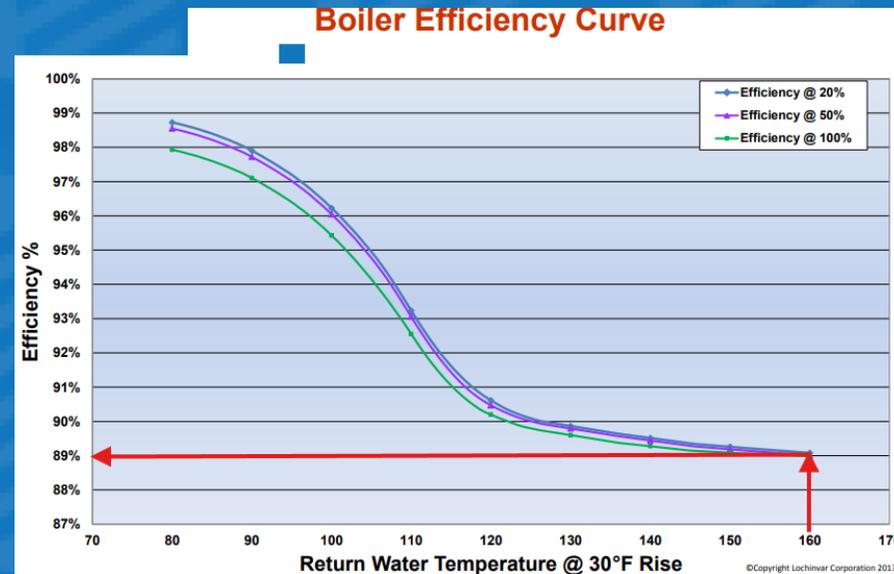

Existing HVAC

Cooling

- 50-ton Daikin chiller installed in 2016 – Good Condition
- Fluid cooler from 2007 (near end of life) – Acceptable Condition
- Issues:
 - Chiller pipe and HX insulation are damaged (likely birds)
 - Fluid cooler is not properly fastened

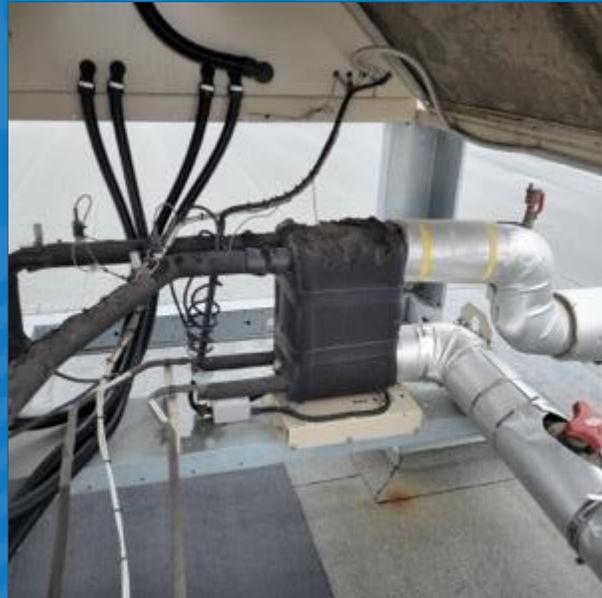



Existing HVAC

Ventilation

- Single Custom Maid McQuay AHU
- Issues:
 - Originally installed and reached its end of reliable service life
 - Significantly oversized. The unit is 10,000 cfm, while ASHRAE 62.1 (Ventilation in commercial buildings) only requires 3,000 cfm
 - The Oversizing is the reason of the poor performance of the generally well-maintained building



Existing HVAC



Domestic Hot Water

- One storage tank heater by the boiler plant
- One electric tank heater
- Issues:
 - Both reached the end of reliable service life
 - The storage tank is connected to the boiler plant, preventing it from working in a condensing range and decreasing overall efficiency

Electrical Capacity

- 600 V, 3-phase service
- 750 kVa Transformer and 800 A rated Distribution service
- Peak load is 88.9 kW within the last 3 years
- Building Capacity: 560 kW.
- Available Capacity: 471 kW

ENERGY MODEL

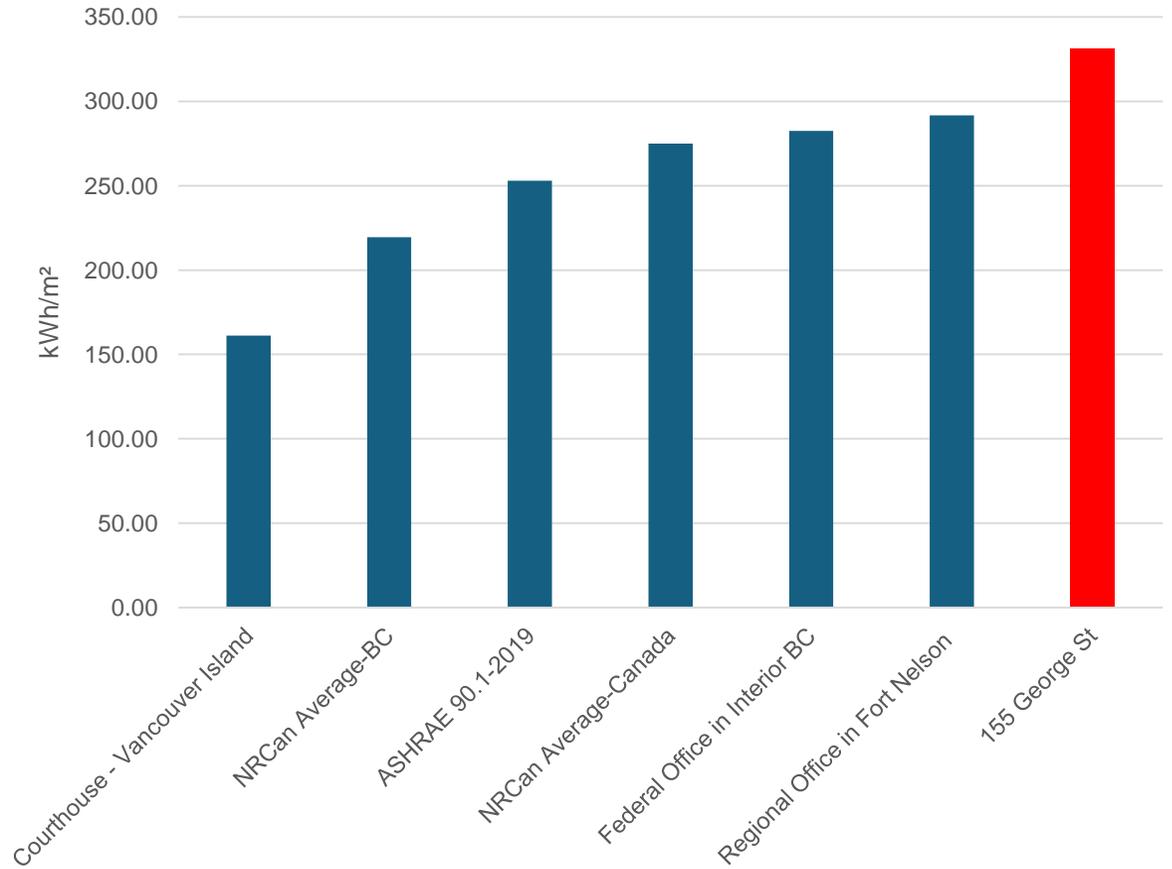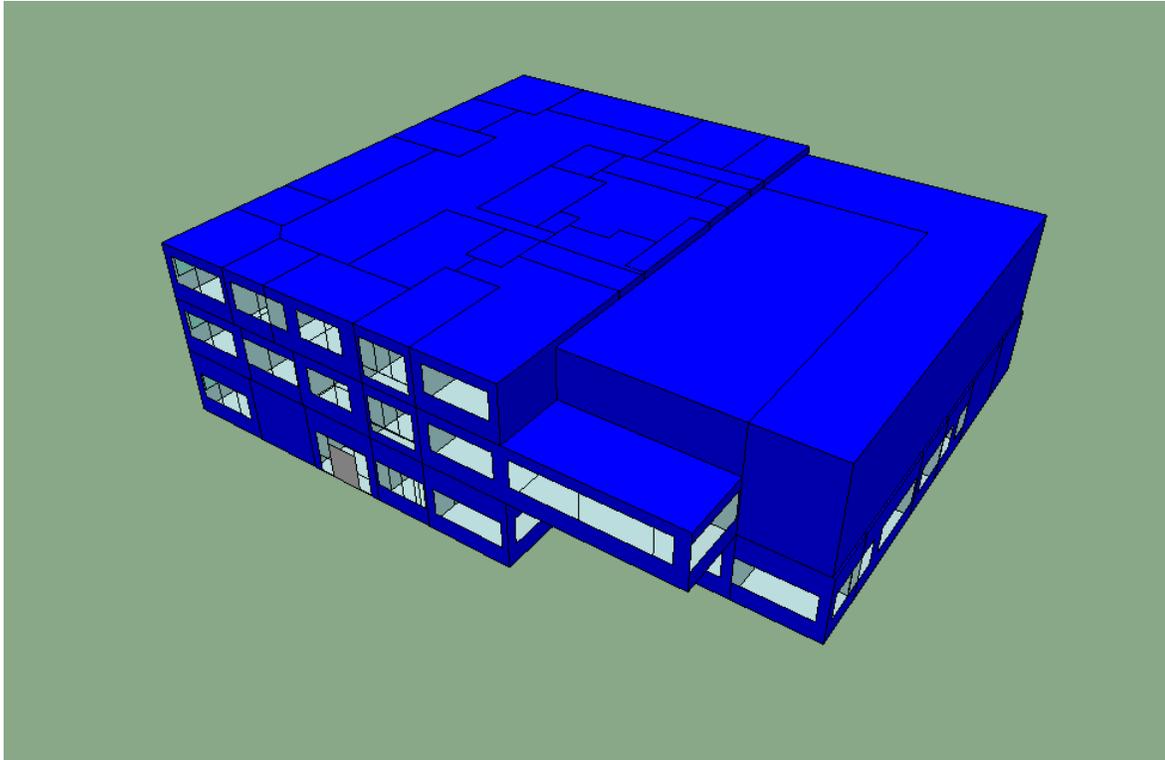

SCENARIO	BASELINE – UTILITY BILLS	BASELINE - SIMULATED	MAE	CVRMSE
Gas Consumption (kWh)	567,305.81	567,612.10	0.05%	14%
Electricity Consumption (kWh)	375,800.00	365,742.90	-2.7%	5%

SUSTAINABLE REPLACEMENT OPTIONS

- Option 1: Existing System Optimization
- Option 2: Geothermal System
- Option 3: Electrification
- Option 4: District Energy System
- Solar PV System



SUSTAINABLE REPLACEMENT OPTIONS

0. Baseline

Scope
Boiler Replacements EOL
AHU Replacement ASAP
Chiller replaced at EOL
Fan Coils replaced at EOL

Parameter	Impact
Energy Use	-0 GJ
Greenhouse Gas Emissions	- 0 Ton CO2e
Energy Costs	-\$0
Capital Costs	\$810,000.00
Financial Metrics (SPP/IRR/NPV)	N/A





SUSTAINABLE REPLACEMENT OPTIONS

1. Existing System Optimization

Scope
Boiler Plant Redesign
AHU Replacement and downsizing
Chiller replaced at EOL
Fan Coils

Parameter	Impact
Energy Use	-798 GJ
Greenhouse Gas Emissions	-41.5 Ton CO2e
Energy Costs	-\$12,504.92
Capital Costs	\$952,000.00
Financial Metrics (SPP/IRR/NPV)	11y/ 7% / \$75,749.99





SUSTAINABLE REPLACEMENT OPTIONS

2 Geothermal

Scope
Water to Water Heat Pumps
Boreholes and resurfacing
AHU Replacement and downsizing
Fan Coils

Parameter	Impact
Energy Use	-1,143 GJ
Greenhouse Gas Emissions	-72.88 Ton CO2e
Energy Costs	-\$7,750.70
Capital Costs	\$1,117,000.00
Financial Metrics (SPP/IRR/NPV)	40y/ -3% / -\$172,035.99





SUSTAINABLE REPLACEMENT OPTIONS

3 Electrification

Scope
Electric Boiler Plant
Chiller at EOL
AHU Replacement and downsizing
Fan Coils at EOL

Parameter	Impact
Energy Use	-976 GJ
Greenhouse Gas Emissions	-102.89 Ton CO2e
Energy Costs	\$7,372.89
Capital Costs	\$612,000.00
Financial Metrics (SPP/IRR/NPV)	N/A





SUSTAINABLE REPLACEMENT OPTIONS

4 District Energy System

Scope
Heat Exchangers and Connection to DES
Chiller at EOL
AHU Replacement and downsizing
Fan Coils at EOL

Parameter	Impact
Energy Use	-2,071 GJ
Greenhouse Gas Emissions	-92.11 Ton CO2e
Energy Costs	\$2,337.54
Capital Costs	\$765,000.00
Financial Metrics (SPP/IRR/NPV)	N/A/ N/A/ 82,221.35





SUSTAINABLE REPLACEMENT OPTIONS

5 Solar

Scope
No HVAC Scope
PV panels

Parameter	Impact
Energy Use	-144 GJ
Greenhouse Gas Emissions	-0.62 Ton CO2e
Energy Costs	-\$3,685.82
Capital Costs	\$135,000.00
Financial Metrics (SPP/IRR/NPV)	37y/ -3% / -\$70,818.19



Incentives and Rebates

Fortis
BC

• \$118,350

Clean
BC

• \$184,220

FCM

• \$153,000

THANK YOU

PHONE
604-255-0992

EMAIL
info@mccuaig.net

WEB
www.mccuaig.net

